

# DYNAMIC REAL-TIME OPTIMISER FOR PRECIPITATION SOLIDS CONTROL

D'Agostino A<sup>1\*</sup>, and Grange GL<sup>2\*</sup>

<sup>1</sup>Process Control, BHP Billiton Worsley Alumina, WA, Australia

<sup>2</sup>Apex Optimisation, WA, Australia

## Abstract

### Background

Maintaining the correct amount of solids in a precipitation circuit is paramount to optimal yield. The challenge lies in removing the right amount of product solids to ensure that the correct amount of solids is recycled. This is further complicated by other factors, such as:

- Planned and unplanned process variations;
- Delays of around two days between operator adjustments and the resulting effect on solids content;
- Not all the adjustments are available on the Process Control System (PCS). For example the removal to or recovery from hydrate storage are discrete field operations.

Historically the amount of solids to be removed was estimated by reviewing historical data and forecasting future process changes. This required a high degree of process experience and knowledge to determine the appropriate target.

### Solution

Initially technologies already in use at the site were considered:

- Cascaded PID control loops - were not appropriate, due to the long process delays.
- Multivariable Predictive Control (MPC) - was not a viable option, as some of the manipulated variables (MVs) were not closed loop controllers.

The innovative use of a Dynamic Real-Time Optimisation technology (patent pending GDOT), created a solution able to handle the open loop and discrete MVs.

### Result

The final outcome was an application that:

- Provided tighter control of the solids content (24% reduction in standard deviation);
- Resulted in a production increase of 10 000t/a;
- Is well accepted by the operations group (uptime of > 98%);
- Delivered a payback period of less than four months.

---

## 1. Introduction

The closed loop control, and therefore optimisation, of processes with significant lags and deadtimes has always been a real challenge. This problem is further amplified in alumina refineries where these dynamics can span multiple days, i.e. the true impact on process changes made today will only be observed in a day or two.

BHP Billiton Worsley Alumina approached Apex Optimisation (Apex), in mid 2009, to propose and implement a control and optimisation solution for such a problem. The specific challenge was around the control of the solids content (and inventory) in a precipitation circuit.

## 2. Process Overview

Maintaining the correct amount of solids in the precipitation circuit is paramount to optimal yield. As in most alumina refineries, it is effectively controlled by removing the product solids and recycling the remaining solids to the lead precipitation tanks.

The challenge lies in removing the appropriate amount of product solids, ensuring that the correct amount of solids is recycled, amongst all the planned and unplanned process variations. The process flow is illustrated in Figure 1 below.

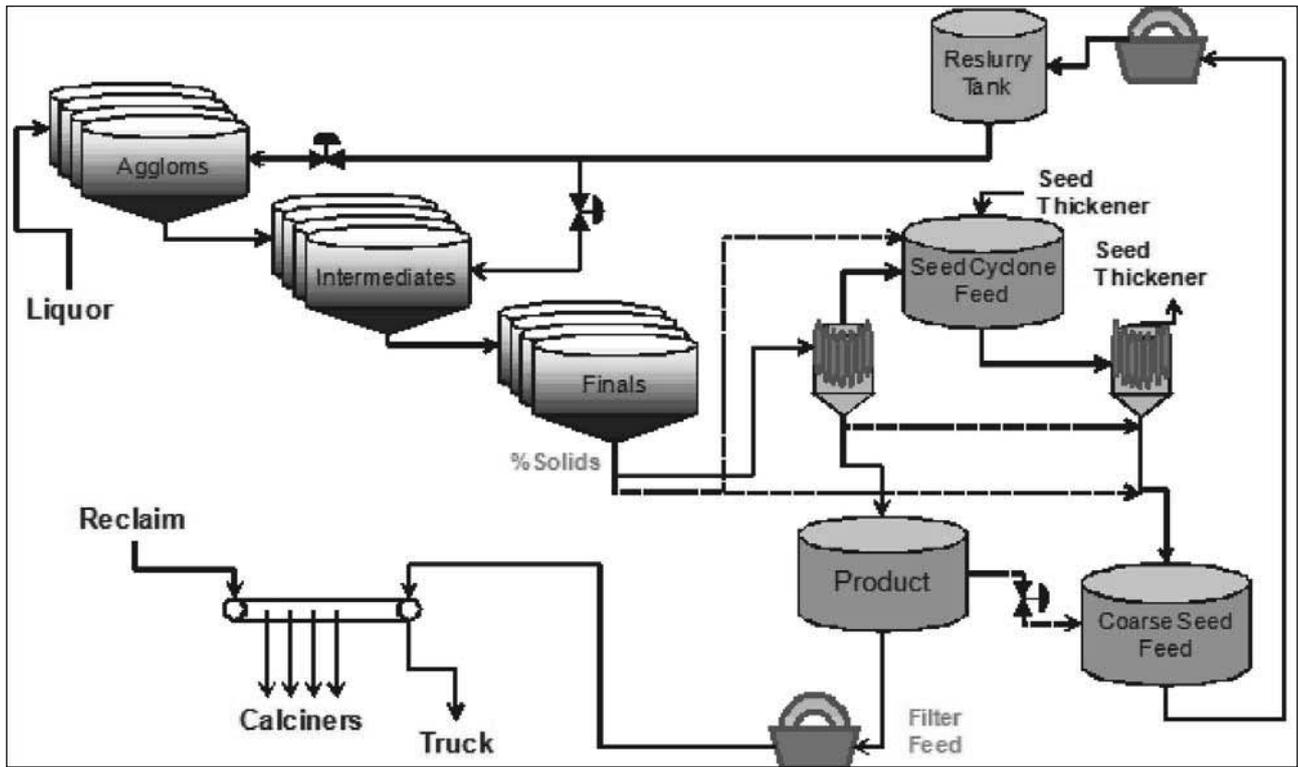


Figure 1 – Precipitation Circuit Process Flow

## 2.1 Challenges Faced

This particular challenge of solids content control has been complicated by a number of process factors. Some of these are:

- The delay of around two days between operator adjustments to the plant and the solids content measurement. This means that the laboratory results at any given time need to be seen in context with the changes in all the process inputs affecting the solids content. It also complicates the determination of any targets, as no real effect will be observed during the shift the changes were made.
- Some adjustments required to manage the amount of product removed are not available on the Process Control System (PCS). That is, the operator needs to co-ordinate manipulation of one closed loop control scheme in conjunction with one of two (very) discrete field operations. There is no closed loop control available at the control panel to manage the removal of product to, or recovery from, hydrate storage.
- Additional manual field adjustments are also required to maintain the correct amount of solids recycled back to precipitation circuit, e.g. online cyclone capacity.

Traditionally the solids content of the precipitation circuit was managed by setting the target for the amount of solids (product) to be removed. This target was estimated by reviewing trends of historical data and forecasting future process changes, with the assumption that the manual field manipulations will be performed correctly in order to meet the target. This approach relied upon a high degree of process experience and understanding of the interactions in order to determine the appropriate solid removal rate from the circuit.

## 2.2 Different Approach

The project team approached the challenge by deconstructing the control problem, allowing them to break the problem down into its core objectives. By using this strategy, the team was able to propose a new approach to solving the control problem.

Instead of setting a target for the amount of product to be removed, the new approach was to specify the appropriate amount of solids required to ensure the solids content of the combined feed streams to the precipitation circuit. The amount of solids required to be removed then becomes a (relatively) simple function of managing the solids inventory, by maintaining the tank levels in the various storage tanks. In turn the amount of product to be removed to, or recovered from, storage is determined by a mass balance.

